


Power Supply Cords




Incorrect

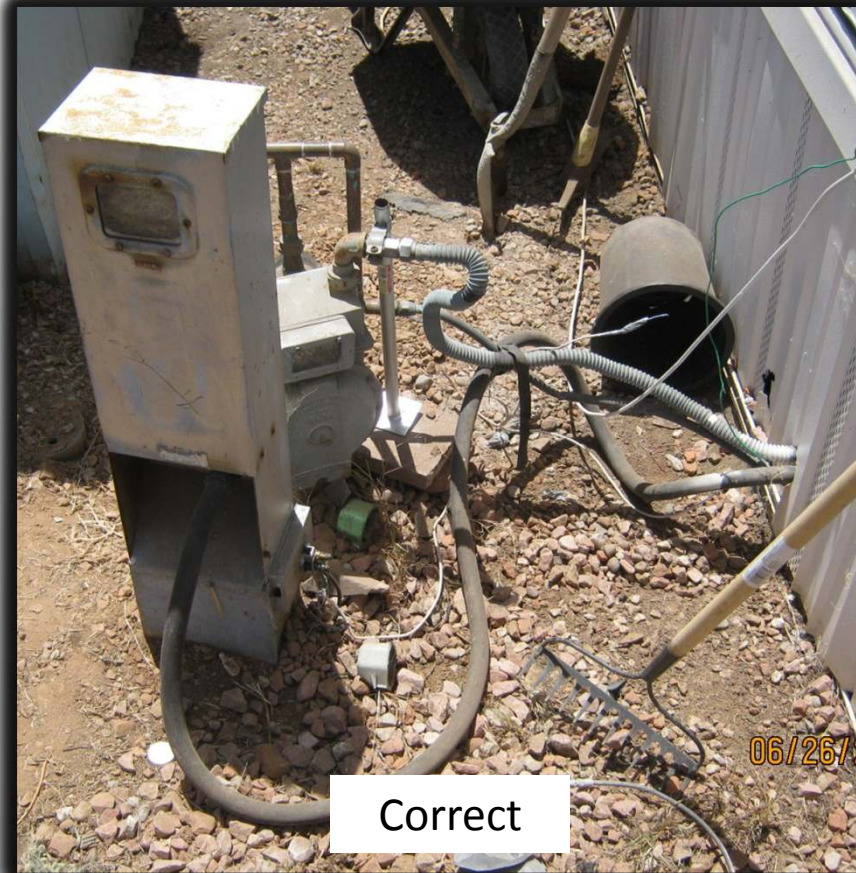

Correct

The power supply cord is buried in the ground or encased in concrete. Remove the dirt or concrete covering and if deteriorated, replace the power supply cord. [25 CCR 1188(b), 1352(g), 2352(f)]

Power Supply Cords

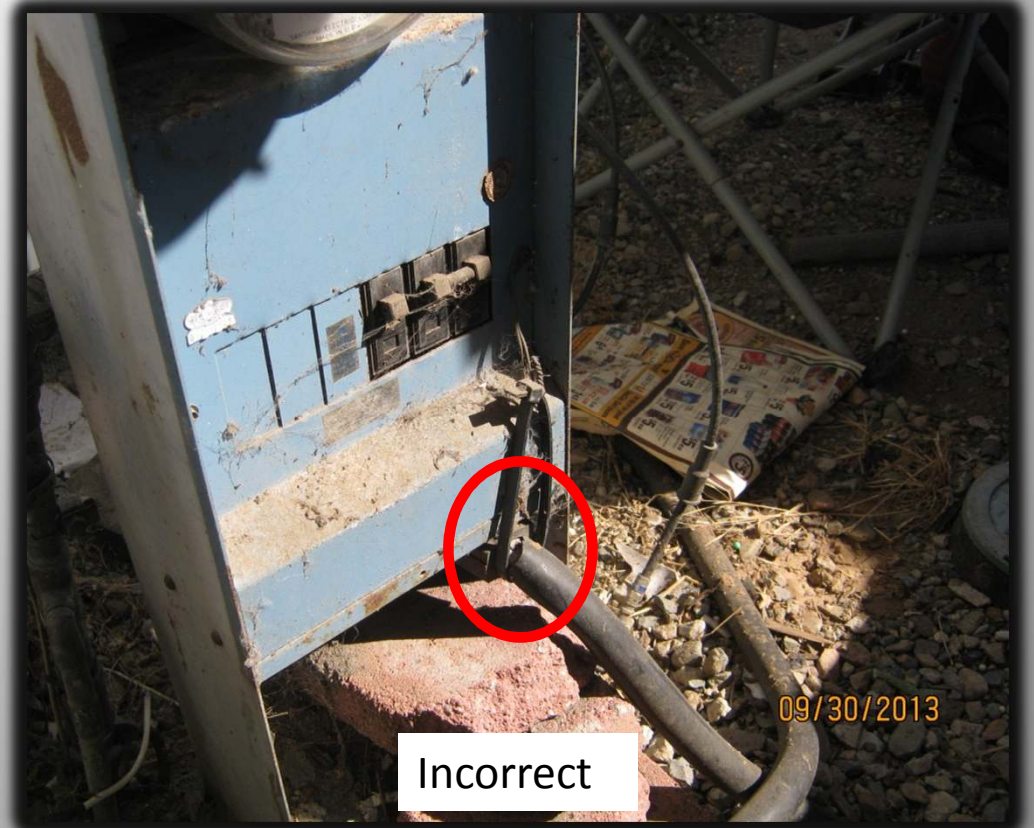

The power cord covering is cracked or deteriorated exposing the conductors. Replace the cord with a cord listed for manufactured home/mobilehome or recreational vehicle use, as appropriate. [25 CCR 1352(a)(1), 1606(d), 1607(d)]

Feeder Assemblies



The MH-unit electrical supply conduit is buried or in direct contact with the earth. Uncover the supply conduit and support above grade. [25 CCR 1352(e), 2352(f)]