




GASOLINE DISPENSING FACILITIES


Vapor Processing Equipment - Bollard Detail

Healy Clean Air Separator / Vapor System Technologies Membrane Processor / Vent Lines

TOP VIEW

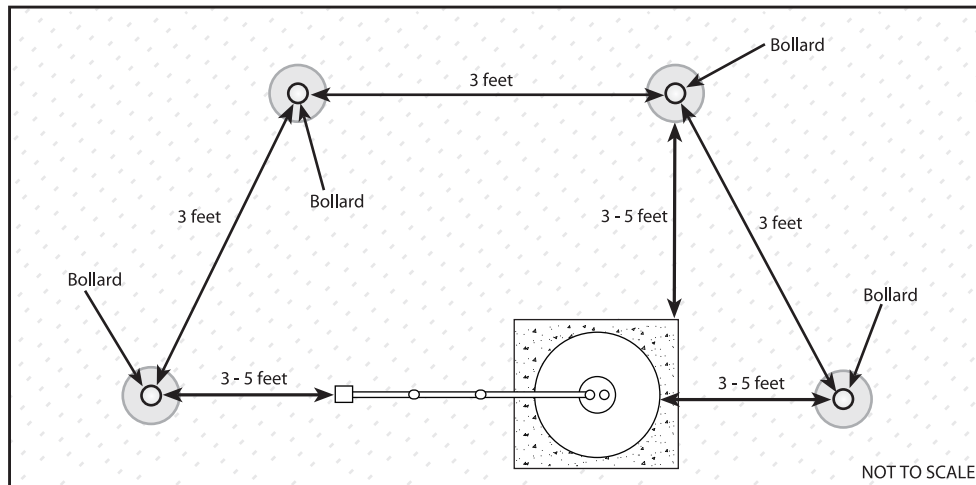

SIDE VIEW

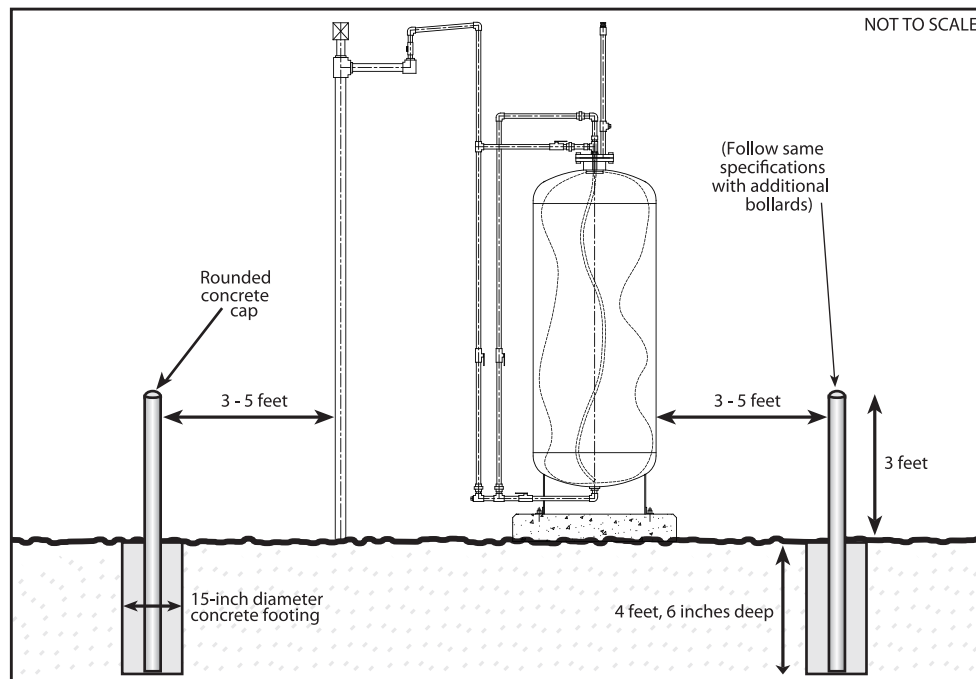

Bollard Specifications

1. Measurements MUST be exact and will be subject to a field inspection
2. Bollards must be 4-inch diameter galvanized steel post (1/4" wall) filled with concrete
3. Bollards must be coated using safety yellow paint.
4. See Phase II EVR upgrade bulletin for specific installation requirements.
5. Bollard layouts shown above are examples only. The number of bollards required will be based on field conditions.