





# COMMERCIAL KNOX BOX REQUIREMENTS

## Multi-Tenant – For Buildings without a Fire Control Room

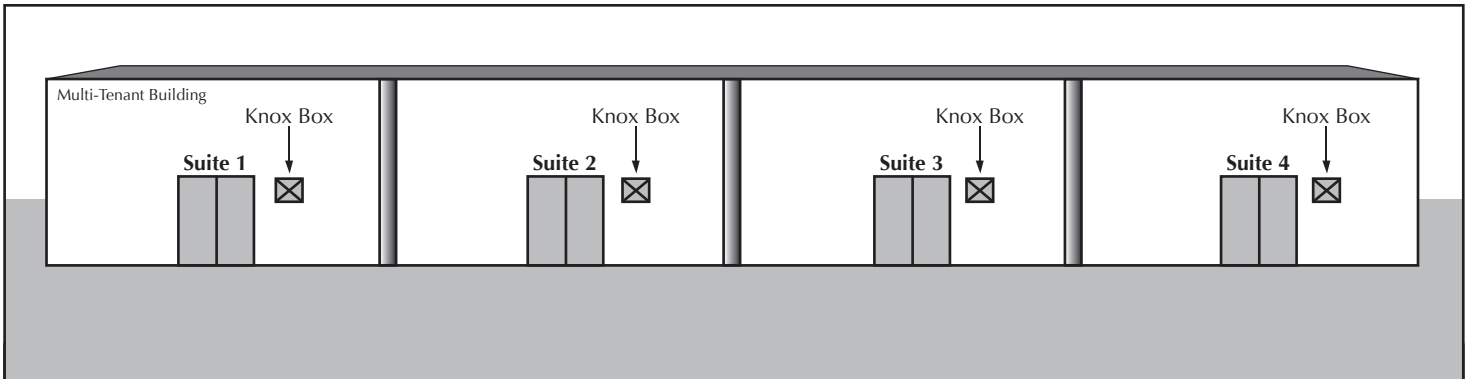

### Main Entrance/Street Facing Side

- Located no further than 2 ft. from main entrance of each suite
- Minimum height = 5 ft. / Maximum = 6 ft.
- Knox Box 3270 Series\* (recessed w/ hinged door)  
\*tamper switch is optional

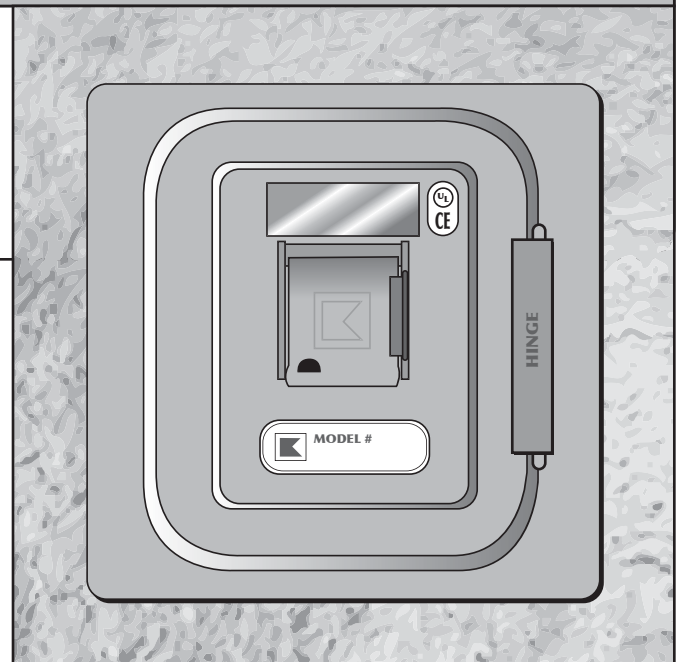

Knox Box

- Multi-tenant commercial buildings are required to provide a Knox Box (3270 Series) for each tenant space
- Some buildings will require additional Knox devices
- The “Fire Department” Alert Decal is to be mounted on the door or frame of the suite’s entrance
- Keys to be placed into the Knox box will be determined by CVFD Fire Prevention Staff (i.e. master key(s), FACP, SDG&E, keys for appliance operation, etc.)
- Required keys shall be secured in Knox box/vault prior to final occupancy certification
- Knox devices can be ordered and purchased at [www.knoxbox.com](http://www.knoxbox.com)
- Install per manufacturer’s instructions