





## Multi-Family Sprinkler Connection (FDC\*) Sign Detail

*\*FDCs located on the building must have a dedicated check valve on the sprinkler riser and receive approval from the Fire Marshal.*

### Detail A - Sign Only

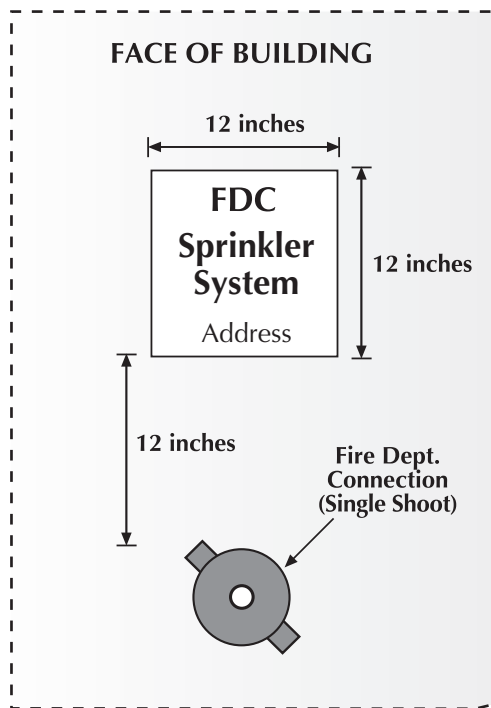

### Detail B - Sign and Building

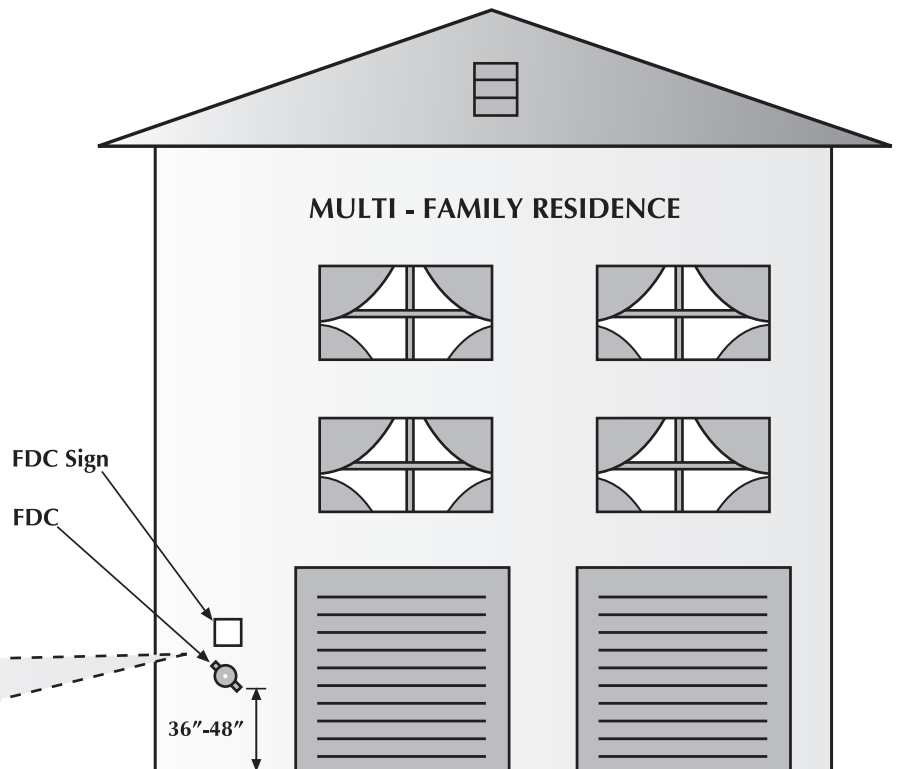

## Sign Specifications

1. Measurements MUST be exact and will be subject to a field inspection.
2. Sign must be .080 gauge aluminum.
3. Sign shall have ASTM TYPE IV high intensity reflective sheeting
4. Protective overlay film on sign [P.O.F].
5. Signage letter height:
  - FDC = 3 inches tall and Address = 1 ¼ inches tall
6. White background with black lettering
7. Sign must be permanently attached to the building (12 inches) above the FDC.

