



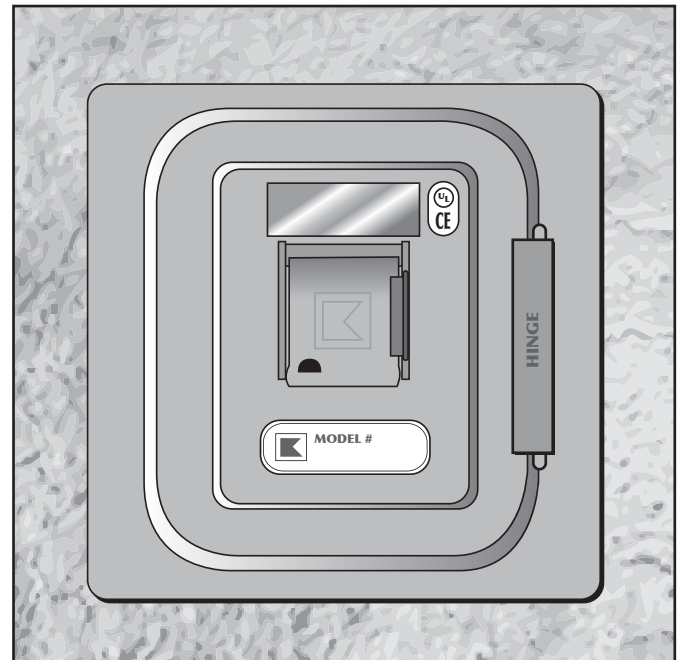

# COMMERCIAL KNOX VAULT REQUIREMENTS

## Single Tenant – For Buildings without a Fire Control Room

- Non-sprinklered, single tenant commercial buildings are required to have a Knox Vault at the main entrance
- Some buildings will require additional Knox devices
- The “Fire Department” Alert Decal is to be mounted on the door or frame of the building’s main entrance
- Keys to be placed into the Knox box will be determined by CVFD Fire Prevention Staff (i.e. master key(s), FACP, SDG&E, keys for appliance operation, etc.)
- Required keys shall be secured in Knox box/vault prior to final occupancy certification
- Knox devices can be ordered and purchased at [www.knoxbox.com](http://www.knoxbox.com)
- Install per manufacturers instructions

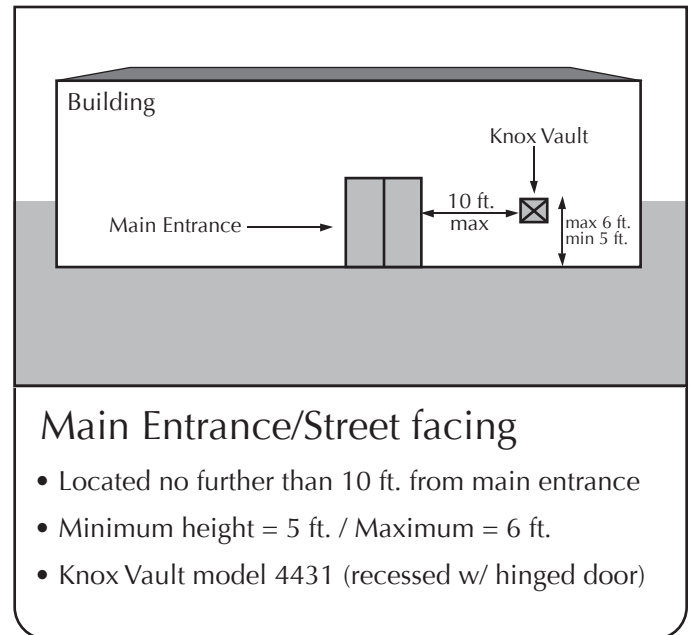

Knox Vault